


KVA	Input Voltage	Input Current
30	480Y277 or 480	54
35	480Y277 or 480	63
40	480Y277 or 480	72
45	480Y277 or 480	81
50	480Y277 or 480	90
55	480Y277 or 480	99
60	480Y277 or 480	108
65	480Y277 or 480	117
70	480Y277 or 480	126
75	480Y277 or 480	135
80	480Y277 or 480	144
85	480Y277 or 480	153
90	480Y277 or 480	162
95	480Y277 or 480	171
100	480Y277 or 480	180
105	480Y277 or 480	189
110	480Y277 or 480	198
115	480Y277 or 480	207
120	480Y277 or 480	216
125	480Y277 or 480	225
130	480Y277 or 480	234
135	480Y277 or 480	243
140	480Y277 or 480	251
145	480Y277 or 480	260
150	480Y277 or 480	269

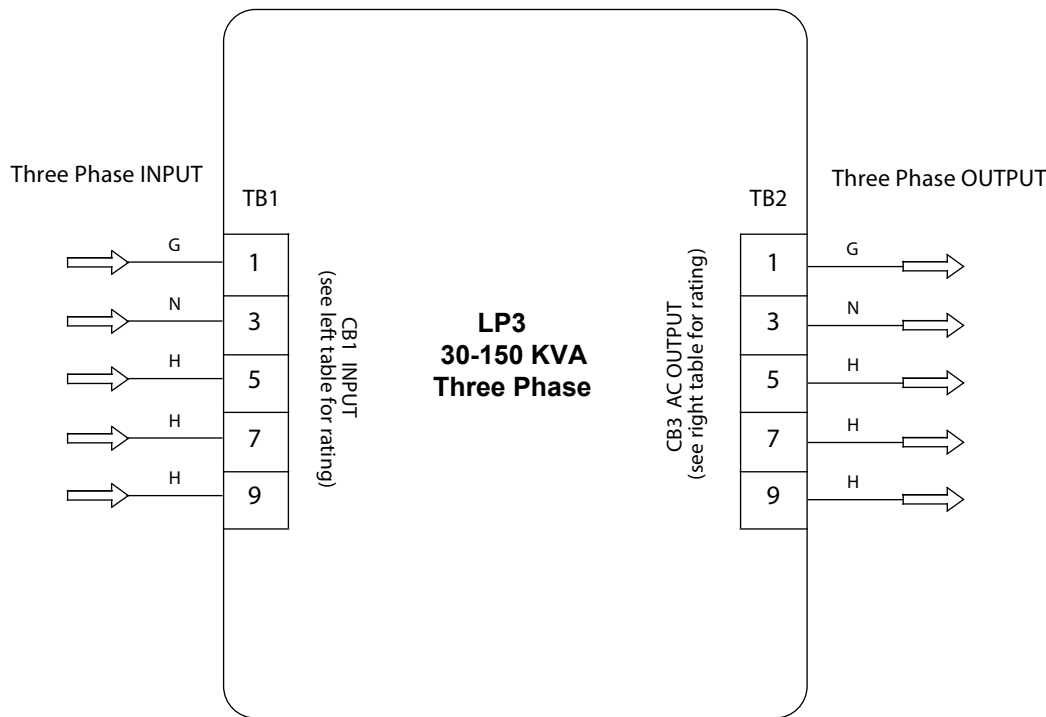

KW	Output Voltage	Output Current
15	208Y120	50
17.5	208Y120	58
20	208Y120	66
22.5	208Y120	75
25	208Y120	83
27.5	208Y120	91
30	208Y120	99
32.5	208Y120	108
35	208Y120	116
37.5	208Y120	124
40	208Y120	133
42.5	208Y120	141
45	208Y120	149
47.5	208Y120	157
50	208Y120	166
52.5	208Y120	174
55	208Y120	182
57.5	208Y120	191
60	208Y120	199
62.5	208Y120	207
65	208Y120	215
67.5	208Y120	224
70	208Y120	232
72.5	208Y120	240
75	208Y120	249

The provided integration drawing is intended solely for elevator motor loads. In situations involving divergent load types, we kindly advise engaging with DSPM for precise input and output maximum current values.