


KVA	Input Voltage	Input Current
30	480Y277 or 480	54
35	480Y277 or 480	63
40	480Y277 or 480	72
45	480Y277 or 480	81
50	480Y277 or 480	90
55	480Y277 or 480	99
60	480Y277 or 480	108
65	480Y277 or 480	117
70	480Y277 or 480	126
75	480Y277 or 480	135
80	480Y277 or 480	144
85	480Y277 or 480	153
90	480Y277 or 480	162
95	480Y277 or 480	171
100	480Y277 or 480	180
105	480Y277 or 480	189
110	480Y277 or 480	198
115	480Y277 or 480	207
120	480Y277 or 480	216
125	480Y277 or 480	225
130	480Y277 or 480	234
135	480Y277 or 480	243
140	480Y277 or 480	251
145	480Y277 or 480	260
150	480Y277 or 480	269

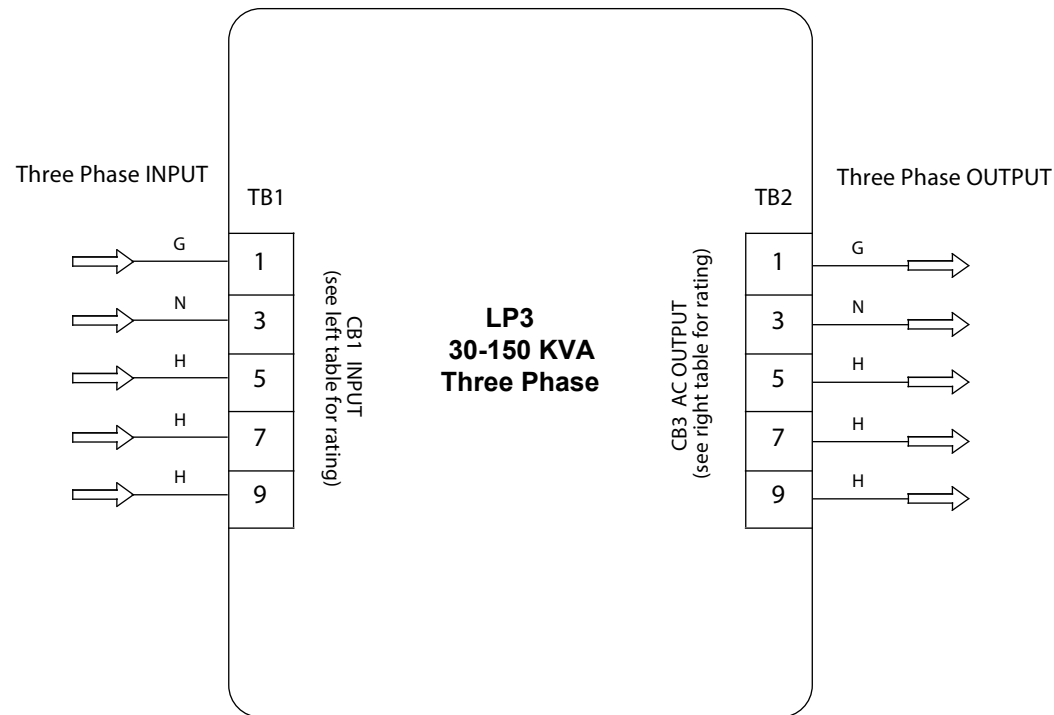

KW	Output Voltage	Output Current
15	480Y277	22
17.5	480Y277	25
20	480Y277	29
22.5	480Y277	32
25	480Y277	36
27.5	480Y277	40
30	480Y277	43
32.5	480Y277	47
35	480Y277	50
37.5	480Y277	54
40	480Y277	57
42.5	480Y277	61
45	480Y277	65
47.5	480Y277	68
50	480Y277	72
52.5	480Y277	75
55	480Y277	79
57.5	480Y277	83
60	480Y277	86
62.5	480Y277	90
65	480Y277	93
67.5	480Y277	97
70	480Y277	101
72.5	480Y277	104
75	480Y277	108

The provided integration drawing is intended solely for elevator motor loads. In situations involving divergent load types, we kindly advise engaging with DSPM for precise input and output maximum current values.